

ISS

REMARKS

DATE

CHKD

APPROV

2

ECN270-63 REV & REDRAWN

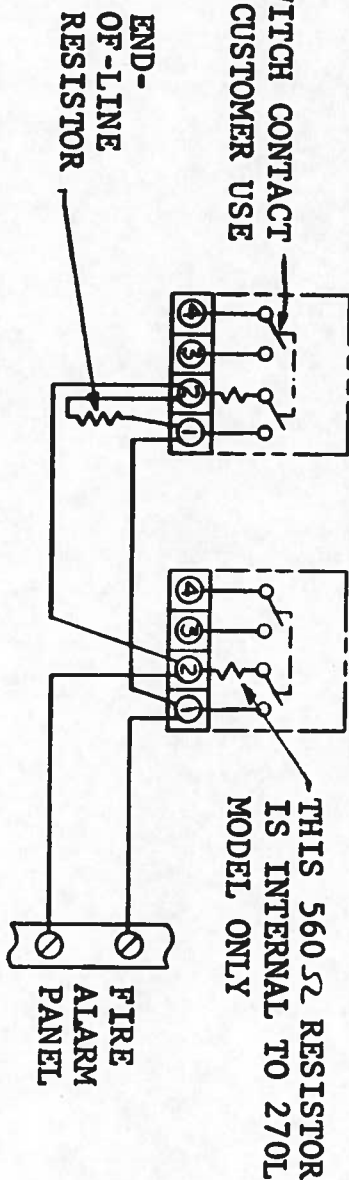
11/1/83

3

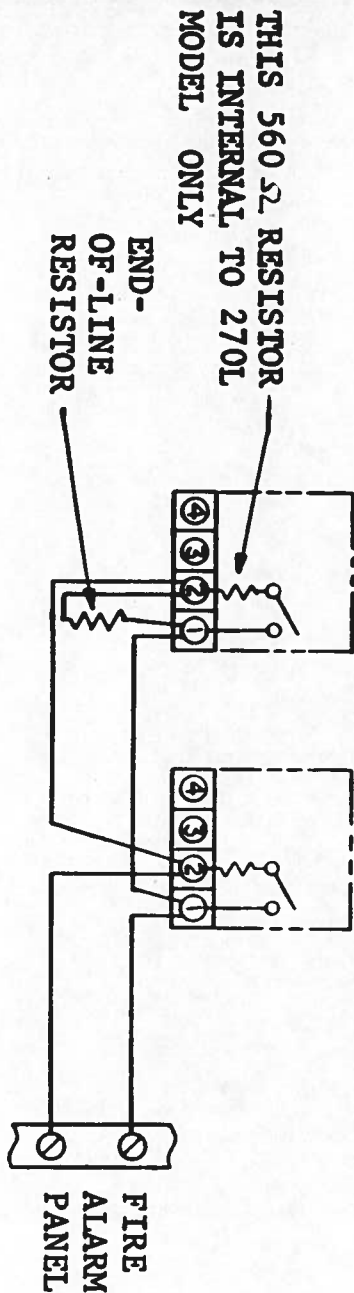
ECN 270-148 ADDED NOTE 2

11/1/83


3/1

DOUBLE POLE NORMALLY OPENSPARE N.O. SWITCH CONTACT
PROVIDED FOR CUSTOMER USE**CATALOG NUMBERS:**

276*-1310 & -1320
278*-1310 & -1320
270-DPO
270L-DPO

SINGLE POLE NORMALLY OPEN**CATALOG NUMBERS:**

276*-1110 & -1120
278*-1110 & -1120
270 - SPO
270L - SPO

**NOTES:**

1. TO ENSURE PROPER SUPERVISION OF CONNECTIONS:
DO NOT USE LOOPED WIRES UNDER TERMINAL SCREWS.
BREAK WIRE RUN. USE BOTH SIDES OF TERMINAL SCREW AS SHOWN IN FIGURE 1.
DO NOT TWIST WIRES TOGETHER.
PARALLEL BRANCHING TO BE AS SHOWN ONLY.
2. INSTALL GLASS ROD AFTER MOUNTING, ON ALL CATALOG 276* AND 278* MODELS.

FIGURE 1

DRFG	4	26
CHKD		
ENGR		
APPROV		
FIRST USED ON		
TITLE:	TYPICAL INSTALLATION WIRING FOR N.O. SINGLE & DOUBLE POLE FIRE ALARM STATIONS	
DWG. NO.	A-F107-174	
REF		
SCALE	SHT	OF

EDWARDS
AN INTEL CORP. COMPANY